CALIFORNIA PAR

CITY OF MISSION VIEJO

Building Division

200 Civic Center Mission Viejo, CA 92691 (949) 470-3054 www.cityofmissionviejo.org

2013 CALIFORNIA CODES

CODE CYCLE

09/30/2015 EFFECTIVE DATE

Solar PV Standard Plan – Simplified Microinverter Systems for One- and Two-Family Dwellings

SCOPE: Use this plan ONLY for systems using utility-interactive Microinverters or AC Modules (ACM) not exceeding a combined system AC inverter output rating of 10 kW, with a maximum of 3 branch circuits, one PV module per inverter and with PV module ISC maximum of 10-A DC, installed on a roof of a one- or two-family dwelling or accessory structure. The photovoltaic system must interconnect to a single-phase AC service panel of 120/240 Vac with service panel bus bar rating of 225 A or less. This plan is not intended for bipolar systems, hybrid systems or systems that utilize storage batteries, charge controllers or trackers. Systems must be in compliance with current California Building Standards Codes and local amendments of the authority having jurisdiction (AHJ). Other articles of the California Electrical Code (CEC) shall apply as specified in section 690.3.

MANUFACTURER'S SPECIFICATION SHEETS MUST BE PROVIDED for proposed inverters, modules, combiner/junction boxes and racking systems. Installation instructions for bonding and grounding equipment shall be provided and local AHJs may require additional details. Listed and labeled equipment shall be installed and used in accordance with any instructions included in the listing or labeling (CEC 110.3). Equipment intended for use with PV system shall be identified and listed for the application CEC 690.4(D).

Applicant and Site Information

Job Address:	Permit #:
Contractor /Engineer Name:	License # and Class:
Signature: Dat	e: Phone Number:
1. General Requirements and System Inf	ormation
☐ Microinverter	AC Module (ACM)
Number of PV modules installed:	Number of ACMs installed:
Number of Microinverters installed:	Note: Listed Alternating-Current Module (ACM) is defined in CEC 690.2 and installed per CEC 690.6
1.1. Number of Branch Circuits, 1, 2 or 3:	
1.2. Actual number of Microinverters or ACMs per bra	ınch circuit: 1 2 3
1.3. Total AC system power rating = (Total Number of	Microinverters or ACMs) * (AC inverter power output)
= Watts	
1.4. Lowest expected ambient temperature for this pluse 1.14 correction factors.	an in Table 1: For -1 to -5°C use 1.12 or for -6 to -10°C
1.5. Average ambient high temperature for this plan: Note: For lower expected ambient or higher average ambier	
2. Microinverter or ACM Information and	d Ratings
Microinverters with ungrounded DC inputs shall be in	stalled in accordance with CEC 690.35.
Microinverter or ACM Manufacturer:	
Model:	
2.1. Rated (continuous) AC output power: Volts	
2.3. Rated (continuous) AC output current:	Amns

If instal	ling AC	CMs, sl	kip [S	TEPS	2.4]
-----------	---------	---------	--------	------	------

2.4. Maximum DC input voltage rating: Volts (limited to 79 V, oth Standard Plan)	herwise us	e the Comprehensive
2.5. Maximum AC output overcurrent protection device (OCPD)		
2.6. Maximum number of Microinverters or ACMs per branch circuit:		
3. PV Module Information		
(If installing ACMs, skip to [STEP 4])		
PV Module Manufacturer:		
Model:		
Module DC output power under standard test conditions (STC) =	_ Watts	
3.1. Module Voc at STC (from module nameplate): Volts		
3.2. Module Isc at STC (from module nameplate): Amps		
3.3. Adjusted PV Module DC voltage at minimum temperature = [Table 1]		[cannot exceed Step 2.4]

Table 1. Module Voc at STC Based on Inverter Maximum DC Input Voltage Derived from CEC 690.7																
Microinverte	_	_	_	_	_	_	_	_	_	_	_	_	_	_		
r Max. DC																
Input																
[STEP 2.4]																
(Volts)																
Max. Module																
VOC @ STC,																
1.12	30.	33.	35.	38.	41.	43.	46.	49.	51.	54.	57.	59.	62.	65.	67.	70.
(-1 to -5°C)	4	0	7	4	1	8	4	1	8	5	1	8	5	2	9	5
Correction																
Factor (Volts)																
Max. Module																
VOC @ STC,																
1.14	29.	32.	35.	37.	40.	43.	45.	48.	50.	53.	56.	58.	61.	64.	66.	69.
(-6 to -10°C)	8	5	1	7	4	0	6	2	9	5	1	8	4	0	7	3
Correction																
Factor (Volts)																

4. Branch Circuit Output Information

Fill in [Table 3] to describe the branch circuit inverter output conductor and OCPD size. Use [Table 2] for determining the OCPD and Minimum Conductor size.

	Table 2. Branch	Circuit OCPD and Minimum	Conductor Size*	
Circuit Current (Amps)	Circuit Power (Watts)	OCPD (Amps)	Minimum Conductor Size (AWG)	Minimum Metal Conduit Size for 6 Current Carrying Conductors
12	2880	15	12	3/4"
16	3840	20	10	3/4"



*CEC 690.8 and 210.19 (A)(1) Factored in Table 2, Conductors are copper, insulation must be 90°C wet-rated. Table 2 values are based on maximum ambient temperature of 69°C, which includes 22°C adder, exposed to direct sunlight, mounted > 0.5 inches above rooftop, ≤ 6 current carrying conductors (3 circuits) in a circular raceway. Otherwise use Comprehensive Standard Plan.

Table 3. PV Array Configuration Summary									
Number of Microinverters or ACMs [STEP 1]									
Selected Conductor Size [Error! Reference source ot found.] (AWG)									
Selected Branch and Inverter Output OCPD [Error! eference source not found.]									

5. Solar Load Center (if used)

- 5.1. Solar Load Center is to have a bus bar rating not less than 100 Amps. Otherwise use Comprehensive Standard Plan.
- 5.2 Circuit Power see [STEP 1] = _____ Watts
- 5.3 Circuit Current = (Circuit Power) / (AC voltage) = _____ Amps

	Table 4. Solar Load Cente	er and Total Inverter Outp	ut OCPD and Conductor Size ³	**
Circuit Current (Amps)	Circuit Power (Watts)	OCPD (Amps)	Minimum Conductor Size (AWG)	Minimum Metal Conduit Size
24	5760	30	10	1/2"
28	6720	35	8	3/4"
32	7680	40	8	3/4"
36	8640	45	8	3/4"
40	9600	50	8	3/4"
41.6	≤ 10000	60	6	3/4"

^{**}CEC 690.8 and 210.19 (A)(1) Factored in Table 4, Conductors are copper, insulation must be 90°C wet-rated. Table 4 values are based on maximum ambient temperature of 47°C (no rooftop temperature adder in this calculation), ≤ 3 current carrying conductors in a circular raceway. Otherwise use Comprehensive Standard Plan.

6. Point of Connection to Utility:

- 6.1. Load Side Connection only! Otherwise use the Comprehensive Standard Plan.
- 6.2. Is the PV OCPD positioned at the opposite end from input feeder location or main OCPD location?
- ☐ Yes ☐ No (If No, then use 100% row in Table 5)
- 6.3 Per 705.12(D)(2): (Combined inverter output OCPD size + Main OCPD size) ≤ [bus bar size × (100% or

Table 5. Maximum Combined Inverter Output Circuit OCPD											
Bus bar Size (Amps)											
Main OCPD (Amps)											
Maximum Combined Inverter OCPD with 120% of bus bar rating (Amps)	20	50	25	60†	60†	40	60†	60†	45		
Maximum Combined Inverter OCPD with 100% of bus bar rating (Amps)	0	25	0	50	25	0	50	25	0		

[†]This plan limits the maximum system size to less than 10 kW, therefore the OCPD size is limited to 60 A. Reduction of Main Breaker is not permitted with this plan.

7. Grounding and Bonding


Check one of the boxes for whether system is grounded or ungrounded:
Grounded Ungrounded

For Microinverters with a grounded DC input, systems must follow the requirements of GEC (CEC 690.47) and EGC (CEC 690.43).

For ACM systems and Microinverters with ungrounded a DC input follow the EGC requirements of (CEC 690.43).

8. Markings


Informational note: ANSI Z535.4 provides guidelines for the design of safety signs and labels for application to products. A phenolic plaque with contrasting colors between the text and background would meet the intent of the code for permanency. No type size is specified, but 20 point (3/8") should be considered the minimum.

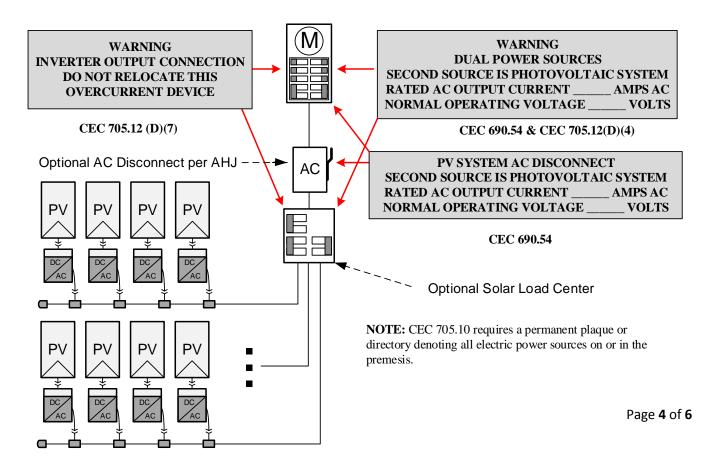

Solar PV Standard Plan — Simplified

Central/String Inverter Systems for One- and Two-Family Dwellings

9. Single-Inverter Line Diagram

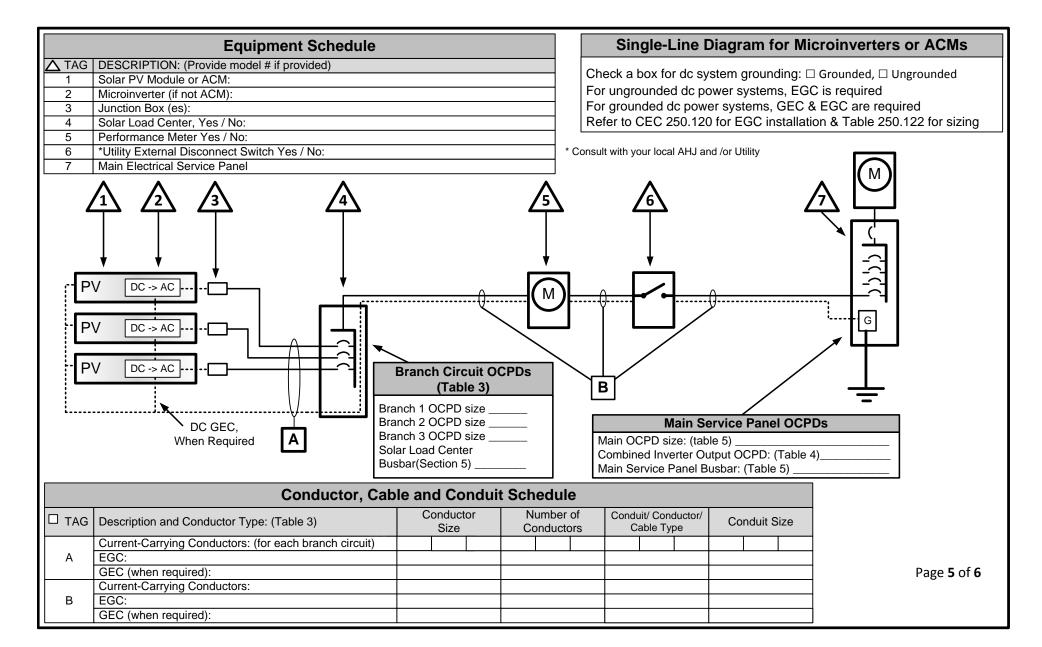

SOLAR PV STANDAR PLAN - SIMPLIFIED Microinverter and ACM Systems for One- and Two-Family Dwellings **ROOF LAYOUT PLAN**

Items required: roof layout of all panels, modules, clear access pathways and approximate locations of electrical disconnecting means and roof access points.